INOVANCE

FORWARD, ALWAYS PROGRESSING

PS00007034 A00

GL20-0800END Digital Input Module

User Guide

Shenzhen Inovance Technology Co., Ltd.

Add.: Inovance Headquarters Tower, High-tech Industrial Park,
Guanlan Street, Longhua New District, Shenzhen
Tel:(0755) 2979 9595 Fax: (0755) 2961 9897
www.inovance.com

Preface

■ About this Guide

GL20-0800END series 8-channel digital input module supports input of sink and source types, and can be used with Easy series products and GL20 series communication interface module such as GL20-RTU-ECT.

This guide describes the mechanical installation, electrical installation and programming examples of the product.

■ Standard Compliance

The following table lists the certifications, directives, and standards that the product may comply with. For details about the acquired certificates, see the certification marks on the product nameplate.

Certification	Directive Name		Standard
CE certification	EMC directive	2014/30/EU	**24 VDC products** EN 61131-2 **24 VAC products** EN 61131-2 EN 61000-3-2 EN 61000-3-3
	LVD directive	2014/35/EU	EN 61010-1 EN 61010-2-201
	RoHS directive	2011/65/EU amended by (EU) 2015/863	EN IEC 63000
UL/cUL certification	-		UL 61010-1 UL 61010-2-201 UL 61010-2-030 CAN/CSA-C22.2 No. 61010-1 CSA C22.2 NO. 61010-2-201 CSA C22.2 NO. 61010-2-030

Certification	Directive Name	Standard
KCC certification	-	-
EAC certification	-	-

More Data

Data Name	Data Code	Description
GL20-RTU-ECT Communication Interface Module User Guide	PS00004985	This guide describes the installation, wiring and more of the product.

Revision History

Date	Version	Description
September 2022	A00	First release.

How to Obtain

This guide is not delivered with the product. You can obtain the PDF version by the following method:

- Log in to Inovance's website (*www.inovance.com*), choose **Support** > **Download**, search by keyword, and then download the PDF file.
- Scan the QR code on the product with your mobile phone.

Product Warranty Instructions

The warranty period of the product is 18 months as of the date of manufacture (refer to the barcode on the equipment). If otherwise agreed upon, the agreed terms and conditions shall prevail. After the warranty period expires, maintenance will be charged.

Within the warranty period, maintenance will be charged for damages caused by the following:

- Operations not following the user instructions
- Fire, flood, or abnormal voltage

- Use of the product for non-recommended functions
- Use of the product outside the scope of intended use
- Force majeure such as natural disasters, earthquake, lightning strike

The maintenance fee is charged according to the latest Price List of Inovance. If otherwise agreed upon, the terms and conditions in the agreement shall prevail.

For details, see Product Warranty Card.

Safety Instructions

■ Safety Precautions

1. Before installing, using, and maintaining this equipment, read the safety information and precautions thoroughly, and comply with them during operations.
2. To ensure the safety of humans and equipment, follow the signs on the equipment and all the safety instructions in this user guide.
3. "CAUTION", "WARNING", and "DANGER" items in the user guide only indicate some of the precautions that need to be followed; they just supplement the safety precautions.
4. Use this equipment according to the designated environment requirements. Damage caused by improper use is not covered by warranty.
5. Inovance shall take no responsibility for any personal injuries or property damage caused by improper use.

■ Safety Levels and Definitions

Danger: Indicates that failure to comply with the notice will result in death or severe personal injuries.

Warning: Indicates that failure to comply with the notice may result in death or severe personal injuries.

Caution: Indicates that failure to comply with the notice may result in minor or moderate personal injuries or damage to the equipment. Please keep this guide well so that it can be read when necessary and forward this guide to the end user.

During Control System Design
Danger • Provide a safety circuit outside the PLC so that the control system can still work safely once external power failure or PLC fault occurs. • Add a fuse or circuit breaker because the module may smoke or catch fire due to long-time overcurrent caused by operation above rated current or load short-circuit.

Warning

- An emergency stop circuit, a protection circuit, a forward/reverse operation interlocked circuit, and a upper position limit and lower position limit interlocked circuit must be set in the external circuits of PLC to prevent damage to the machine.
- To ensure safe operation, for the output signals that may cause critical accidents, please design external protection circuit and safety mechanism;
- Once PLC CPU detects abnormality in the system , all outputs may be closed; however, when a fault occurs in the controller circuit, the output may not be under control. Therefore, it is necessary to design an appropriate external control circuit to ensure normal operation.
- If the PLC output units such as relays or transistors are damaged, the output may fail to switch between ON and OFF states according to the commands.
- The PLC is designed to be used in indoor electrical environment (overvoltage category II). The power supply must have a system-level lightning protection device, assuring that overvoltage due to lightning shock cannot be applied to the PLC power supply input terminals, signal input terminals and output terminals and so forth, so as to avoid damage to the equipment.

Installation

Warning

- Installation must be carried out by the specialists who have received the necessary electrical training and understood enough electrical knowledge.
- Disconnect all external power supplies of the system before removing/installing the module. Failure to do so may result in electric shock, module fault or malfunction.
- Do not use the PLC where there are dust, oil smoke, conductive dust, corrosive or combustible gases, or exposed to high temperature, condensation, wind & rain, or subject to vibration and impact. Electric shock, fire and malfunction may also result in damage or deterioration to the product.
- The PLC is open-type equipment that must be installed in a control cabinet with lock (cabinet housing protection > IP20). Only the personnel who have received the necessary electrical training and understood enough electrical knowledge can open the cabinet.

Caution

- Prevent metal filings and wire ends from dropping into ventilation holes of the PLC during installation. Failure to comply may result in fire, fault and malfunction.
- Ensure there are no foreign matters on ventilation surface. Failure to comply may result in poor ventilation, which may cause fire, fault and malfunction.
- Ensure the module is connected to the respective connector securely and hook the module firmly. Improper installation may result in malfunction, fault or fall-off.

Wiring

Danger

- Wiring must be carried out by personnel who have received the necessary electrical training and understood enough electrical knowledge.
- Disconnect all external power supplies of the system before wiring. Failure to comply may result in electric shock, module fault or malfunction.
- Install the terminal cover attached to the product before power-on or operation after wiring is completed. Failure to comply may result in electric shock.
- Perform good insulation on terminals so that insulation distance between cables will not reduce after cables are connected to terminals. Failure to comply may result in electric shock or damage to the equipment.

Caution

- To avoid electric shock, cut off the power supply before connecting the product to the power supply.
- The input power of the product must meet the specifications listed in this guide. If the power input does not meet the specifications, the equipment may be damaged. Thus, check regularly that the DC power provided by the switching-mode power supply unit is stable.

During Operation and Maintenance

Caution

- Maintenance & inspection must be carried out by personnel who have the necessary electrical training and experience.
- Do not touch the terminals while the power is on. Failure to comply may result in electric shock or malfunction.
- Disconnect all external power supplies of the system before cleaning the module. Failure to comply may result in electric shock.
- Disconnect all external power supplies of the system before removing the module or connecting/removing the communication wirings. Failure to comply may result in electric shock or malfunction.

Safety Recommendations

- On-site manual devices or other backup means must be equipped in the position where the operator directly touches the mechanical parts, such as loading and unloading mechanical tools, or the position where the machine runs automatically. The manual devices and backup means, which can start or interrupt automatic operations of the system, must be independent of the programmable controller.
- If you need to modify the program while the system is running, use the lock function or other protective measures. Ensure that only authorized personnel can make the necessary modifications.

Disposal

Caution

- Treat the scrapped product as industrial waste. Dispose of the battery according to local laws and regulations.
- Recycle retired equipment by observing industry waste disposal standards to avoid environmental pollution.

1 Product Information

1.1 Model Number and Nameplate

GL 20 -08 00 E N D

① ② ③ ④ ⑤ ⑥ ⑦

① **Product Information** GL: General local module	③ **I/O Points** 8: 8 inputs	⑤ **Module Type** E: Logic I/O expansion module	⑦ **Voltage type** D: 24 VDC
② **Serial Number** 20: 20 series module	④ **I/O Points** 00: 0 output	⑥ **Output type** N: No output	- -

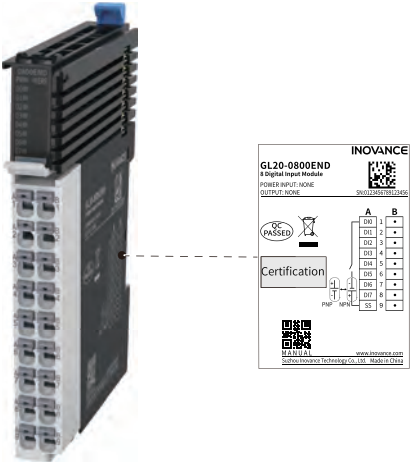

Based on the above description of model number and nameplate, the relevant ordering data of this product is described in the following table.

Model	Description	Product Code	Applicable Model
GL20-0800END	GL20-0800END 8-channel digital input (sink/source) module	01440381	Easy series products and GL20 series communication interface modules such as GL20-RTU-ECT

1.2 Components

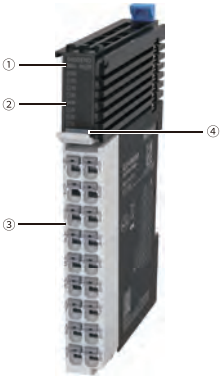

No.	Name	Description			
①	Signal indicators	PR (POWER +RUN)	Power / running indicator	Yellow green	ON when the module is in normal operation Flashes when the module is preparing or stopped OFF when the module is faulty
		ERR	State machine error indicator	Red	ON when hardware error occurs
②	I/O signal indicator	Corresponding to various input signals ON: input active OFF: input inactive			
③	I/O terminal	See Terminal Definition for detailed definition *"3.2 Terminal Definition" on page 17*			

No.	Name	Description	
④	Color identification	Red: Digital output	Orange: Analog output
		Gray: Digital input	Green: Analog input
		White: Communication	Blue: Other module

1.3 Specifications

■ Power supply specifications

Item	Specification
Rated bus input voltage	5 VDC (4.75 VDC to 5.25 VDC)
Rated bus input current	100 mA (typical@5 VDC)
Rated terminal input voltage	/
Rated terminal input current	/
Rated terminal output voltage	/
Rated terminal output current	/
Hot swap	Not supported

■ Input specification

Item	Specification
Input type	Digital input
Input mode	Sink/Source
Input channels	8
Input voltage class	24 VDC±10% (21.6 VDC to 26.4 VDC)
Input current (typical)	4 mA (typical@24 V)
ON voltage	>15 VDC
OFF Voltage	<5 VDC
ON/OFF hardware response time	100 us/100 us
Software filter time	Supported
Input impedance	Reference: 5.3k to 5.6k

Item	Specification
Isolation	Yes
Input action display	Input indicators are turned ON (via software control) when the inputs are in the driving state
Input derating	/

■ Software specifications

Item	Specification
Software input filter time	Options include Without filter, 0.25 ms, 0.5 ms, 1ms (factory setting), 2 ms, 4 ms, 8 ms, 16 ms, and 32 ms.
Input port anomaly detection and indication	/
Input channel logic level configuration	Not supported
Independent channel enable configuration	Not supported
Diagnostic report configuration	Not supported
When in stop mode	Outputs are not refreshed, inputs can be refreshed when in state SAFE-OPERATIONAL
I/O mapping	Supports bitwise, bytewise and wordwise addressing

2 Mechanical Installation

2.1 Mounting Dimensions

■ Module

The mounting dimensions (in mm) are shown in the figure below.





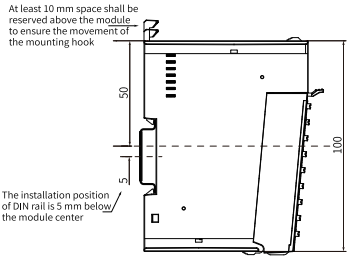

■ Cable Connection

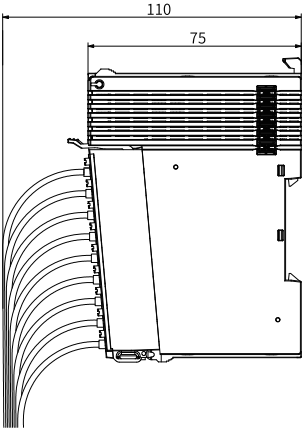

2.2 Installation Method

The module is mounted onto a DIN rail in conformity with EN 60715 (width: 35 mm, thickness: 1 mm). The dimensions (unit: mm) are shown below.



■ Installing Modules Side-by-Side

You can install multiple modules side by side with the help of top and bottom guides on the modules, as shown below.

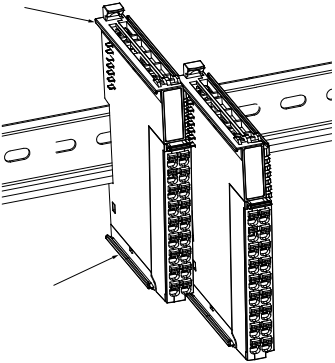

■ Installing Module onto DIN Rail

You can install the module onto a DIN rail. Align the module with the DIN rail and push the module in the direction indicated by the arrow until you hear a click, as shown below.

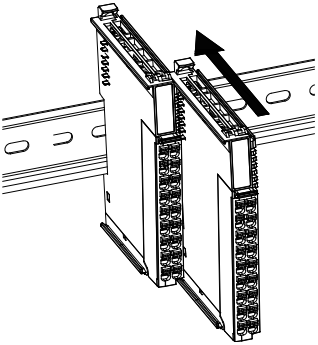

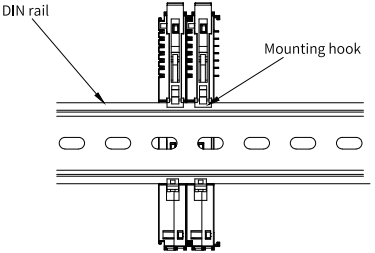

Note: After the module is installed, the DIN rail mounting hook will automatically move downward to lock the module to the rail. If the hook does not move downward, press down the top of the hook to ensure that the module is installed in place.

Mount an end plate on either side of the module assembly. To mount the end plate, hook the bottom of it to the bottom of the DIN rail, rotate the end plate to hook the top of it to the top of the DIN rail, and then tighten the screw to lock the end plate in place, as shown below.

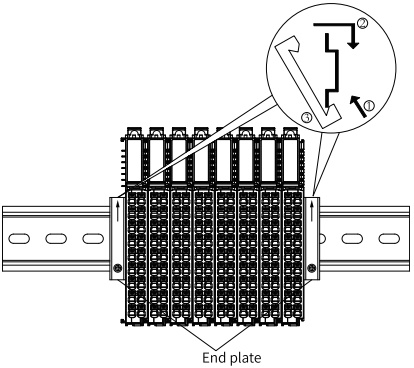

■ Removing Module

Pry the DIN rail mounting hook upwards with a tool such as slotted screwdriver, hold the protrusions and pull the module out straight forward, and then press down the top of the DIN rail mounting hook.

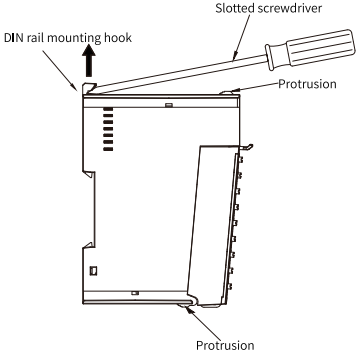

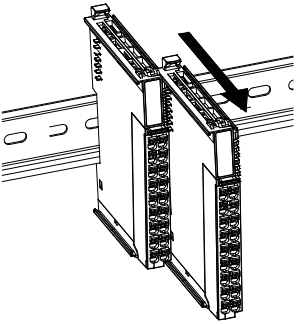

3 Electrical Installation

3.1 Cable Selection

The cable lug and cable diameter included in the following table are only for reference.

Material Name	Applicable Cable Diameter		KST		Suzhou Yuanli	
	mm^2	AWG	Model	Crimping Tool	Model	Crimping Tool
Tubular lug	0.3	22	E0308	KST2000L	0308	YAC-5
	0.5	20	E0508		0508	
	0.75	18	E7508		7508	
	1.0	18	E1008		1008	
	1.5	16	E1508		1508	

If you use other types of tubular lug, crimp the lug to the cables according to the shape and dimension requirements shown in the figure below.

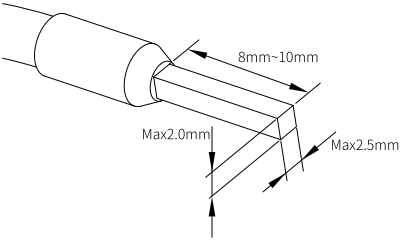

3.2 Terminal Definition

Left Indicator	Left Signal	Left Terminal	Right Terminal	Right Signal	Right Indicator
00	DI0	A1	B1	•	/
01	DI1	A2	B2	•	/
02	DI2	A3	B3	•	/
03	DI3	A4	B4	•	/
04	DI4	A5	B5	•	/
05	DI5	A6	B6	•	/
06	DI6	A7	B7	•	/
07	DI7	A8	B8	•	/
/	SS	A9	B9	•	/

3.3 Terminal Wiring

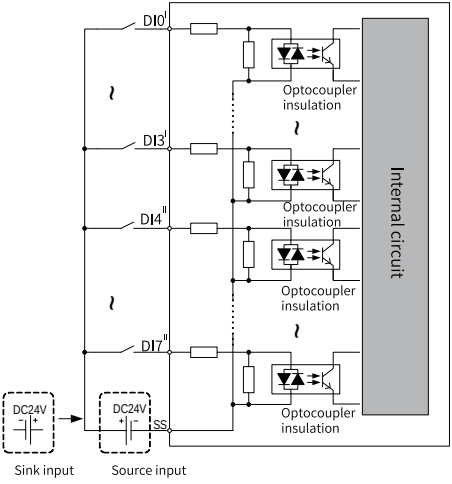

4 Programming Examples

The following is an example where the input voltage of channel 0 of the GL20-0800END module is assigned to the corresponding variable, and AM600 is used as the main control module.

1. Add the GL20-0800END module.

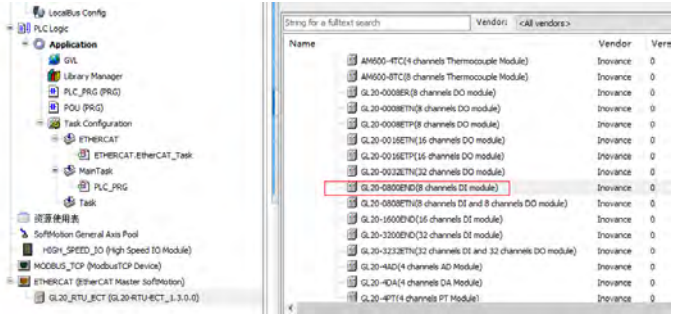

2. Double-click the module and in the **Channels Config** interface, modify the filter parameter.

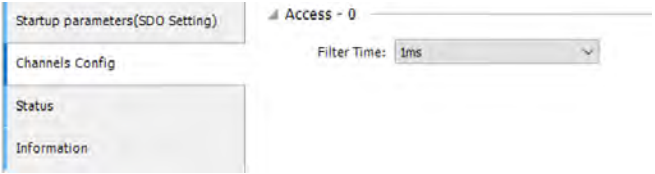

3. Add a custom variable ch0.



Scope	Name	Address	Data type	Initialization	Persistent	Constant	Comment	Attributes
VAR_GLOBAL	ch0		INT		☐	☐		

4. Map ch0 to channel 0 of the configured module.

Variable	Mapping	Channel	Address	Type	Default Value	Unit	Description
		Device control	%QW1	UINT			Device control
		LBus status	%IW1	UINT			LBus status
		Fault ID	%IW2	UINT			Fault ID
Application.ch0		GL20_0800END Digital input 8bit	%IB6	USINT			GL20_0800END Digital input 8bit

5. Define a variable D0 with the LD programming language.

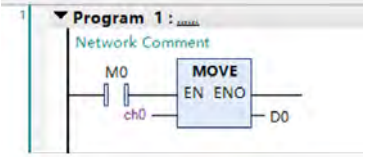

6. After successful compiling, download the project and run it.